




Z-CHILL[™] INSTALLATION GUIDE

 Follow the Factory Mutual Insurance Company (FM Global) standards, Heating equipment manufacturer's guideline and safety standards such as those published by the National Fire Protection Association (NFPA), and the American Society for Heating, Refrigeration and Air Conditioning Engineers (ASHRAE), and local code authorities.

 Go Fan Yourself recommends the Z-Chill[™] system blowers be connected to the fire suppression system in addition to the Z-Tech[™] fan.

- The Z-Chill[™] System requires a 2 FT Down Tube. If you are retrofitting this to an existing GFY Z-Tech[™] fan with the standard 1 FT Down Tube that Down Tube must be removed and replaced with a 2 FT Down Tube as part of the retrofit process. See the Z-Tech[™] installation manual for details.
- This manual contains information on the assembly of Z-Chill[™] only. Please see the GFY Z-Tech[™] installation manual for all instructions regarding the fan.

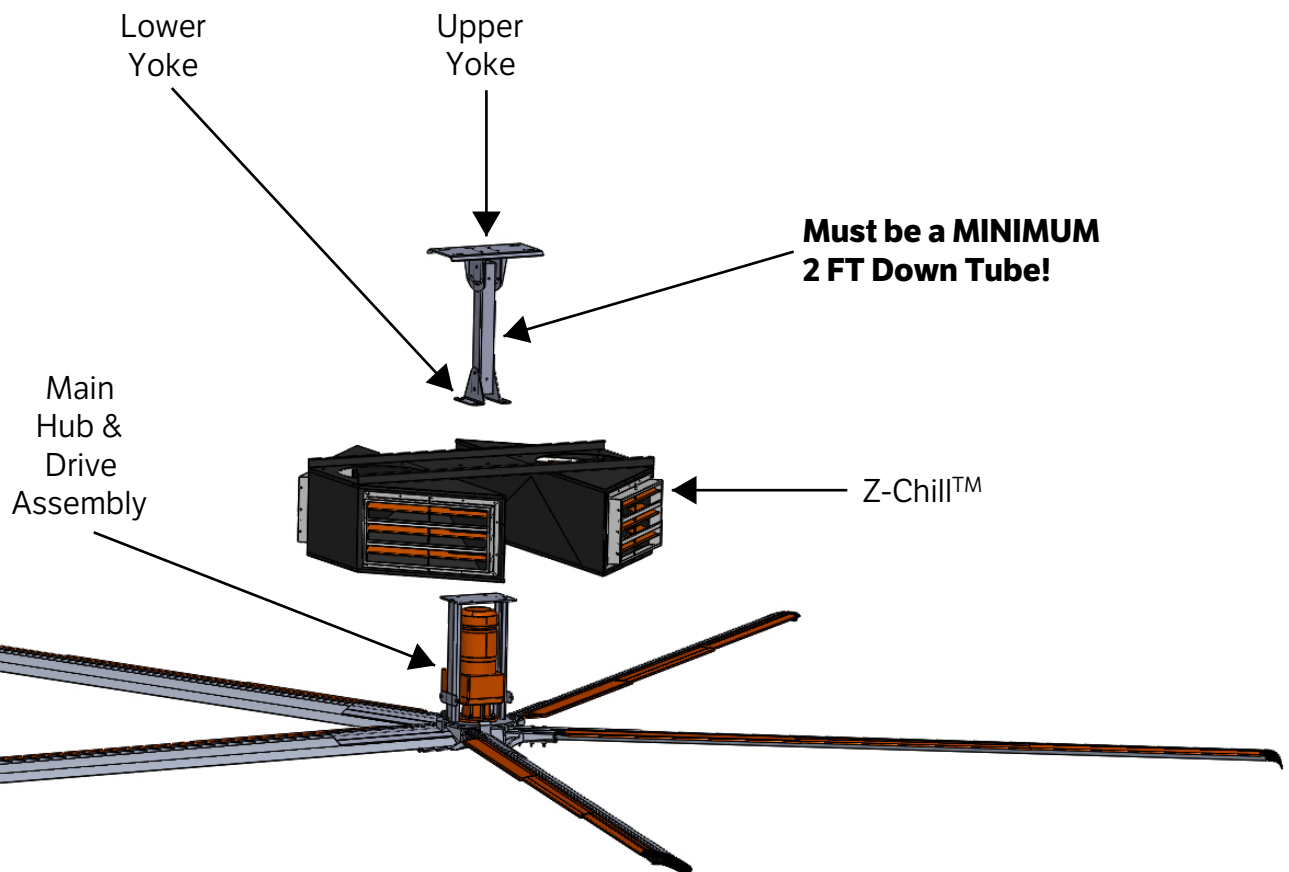


Your Z-Chill[™] Kit consists of:
(2) Louver Assemblies
(1) Mounting Plate
(1) Hardware Box

Assemble Z-Chill[™]:


- a) Once you have completed installation of the Down Tube and secured the Upper Safety Cable assemble the Z-Chill[™] Louvers to the Mounting Plate using:
 - i) (8) 3/8"x16 x1" Grade 8 Hex Cap Screws
 - ii) (8) 3/8"x16 Grade 8 Nylock Nuts
 - iii) (16) 3/8" Yellow Zinc Washers
 - iv) (8) Washer Plates

Refer to Steps 4 & 5, Figures 7,8,10, & 11, on pages 10 & 11 of the GFY Z-Tech[™] installation manual.

- 1) Place the Louver Assemblies and Mounting Plate so the large air duct holes and the (4) anchor holes align.
- 2) Secure the Louver Assemblies to the Mounting Plate using the hardware listed above.

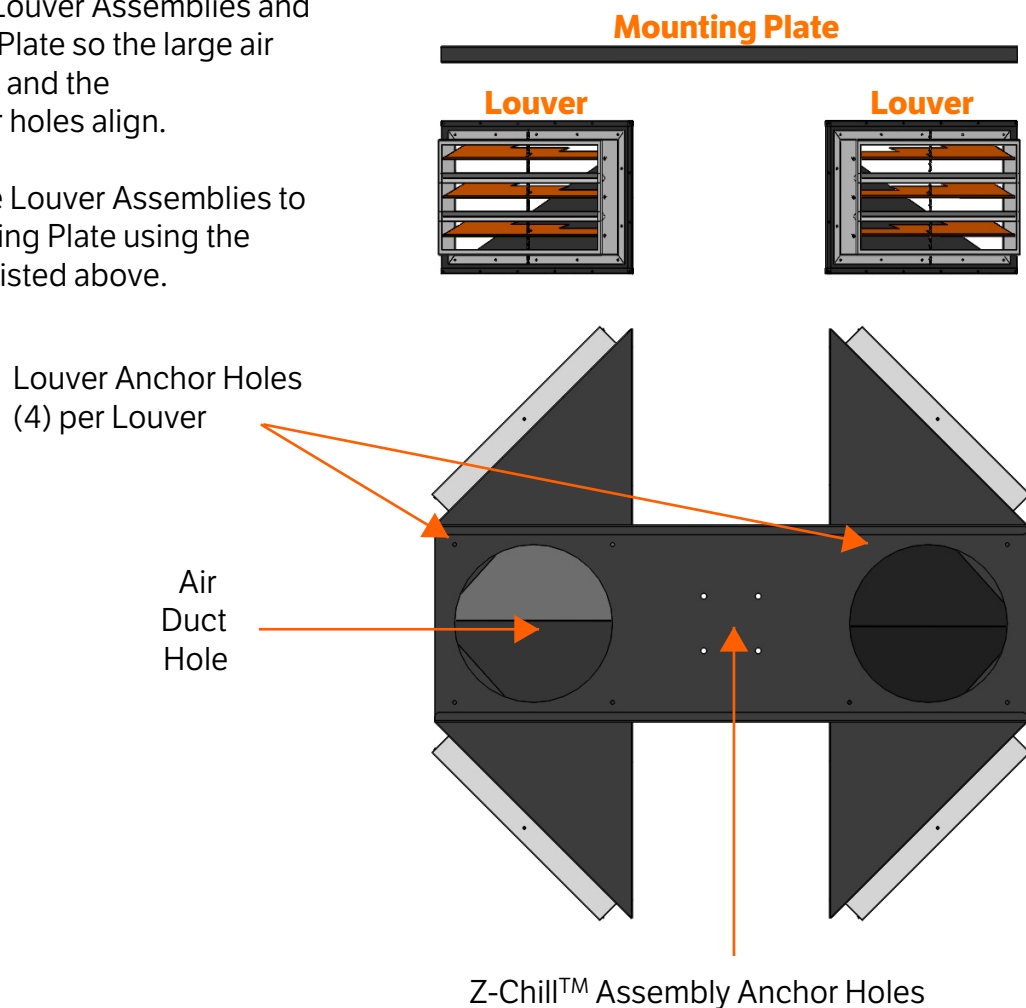

- 2) Loosely secure the assembled Z-Chill[™] to the Main Hub & Drive Assembly:
 - a) With the Main Hub & Drive Assembly resting on a skid, lift the assembled Z-Chill[™] onto the Main Hub and Drive Assembly.
 - b) Be sure to align Z-Chill[™] so the area between the Louvers is open to allow access to the motor power cover plate.
 - c) Loosely tighten the nuts to hold Z-Chill[™] in place on the Main Hub and Drive Assembly using the hardware supplied with the fan to anchor the Main Hub and Drive Assembly to the Lower Yoke at the bottom of the Down Tube.
 - i) (4) 1/2"x13x1.5" Grade 8 Hex Cap Screw
 - ii) (8) 1/2" ASTM F436 Type 1 Mechanical Galvanized Steel Structural Flat Washer
 - iii) (4) 1/2"x13 Grade 5 Steel Nylock Nut
- 3) Lift the Z-Chill[™] System onto the lift using a forklift.
- 4) Raise into place beneath the Lower Yoke.

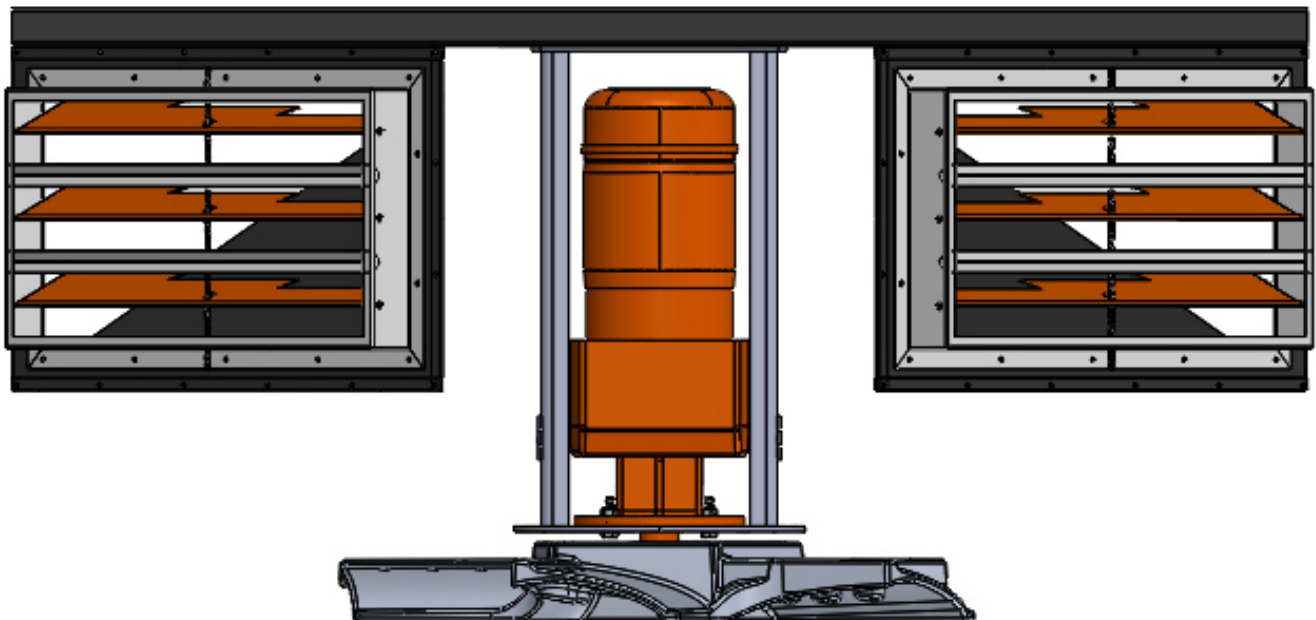

- 5) Align the Z-Chill[™] System with the mounting holes in the Lower Yoke and secure with the hardware provided as listed on page 3 of this manual.
 - a) Reference GFY Z-Tech[™] installation manual page 12, Figure 13 and complete your fan installation per that manual.

